
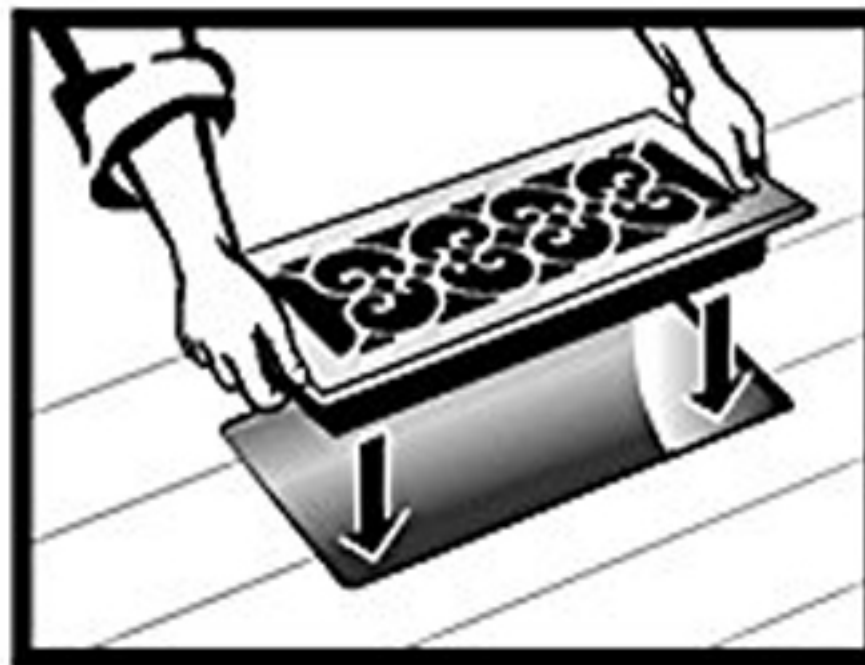


DECOR GRATES®

How to Choose Registers, Grilles and Diffusers

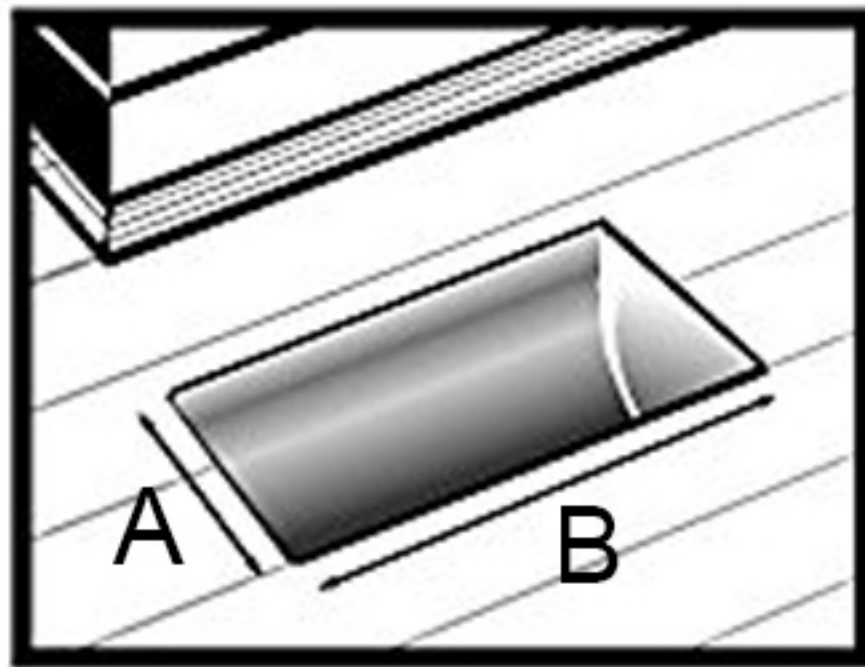

- Confirm the location of the opening:
Floor, wall or ceiling
- Measure the size of the airduct opening, A" x B"
not the register or grille, e.g. 4" x 10" or 6" by 12"
- Determine if the opening is a supply
(Register) or return (Grille)