



**Please refer  
to page 22 for  
GenerLink testing,  
while utility  
power is present.**



# | Operating Manual

[www.generlink.com](http://www.generlink.com)

MA23-N (unit without whole house surge suppression)

MA23-S (unit with whole house surge suppression)

MA24-N (unit without whole house surge suppression)

MA24-S (unit with whole house surge suppression)

# Terms and Conditions of Usage

---

**TERMS AND CONDITIONS.** Upon breaking the seal attached to the installed GenerLink™, you expressly agree that usage is restricted and subject to the following terms and conditions (“Terms and Conditions”).

**INSTALLATION AND CARE OF PROPERTY.** The GenerLink™ unit must be installed by an Approved Installer and may not be removed or modified by anyone other than an Approved Installer. An Approved Installer is defined as a licensed electrician or a technician approved by your local electric utility (“Utility”). As a user of GenerLink™, you further agree to follow the GenerLink™ Start-Up Procedure provided in the Operating Manual, incorporated herein by reference. At all times, the GenerLink™ unit shall be used solely for the purpose intended, in accordance with the Instructions and “Safety Tips,” contained in this Operating Manual, incorporated herein by reference. You understand that any installation, removal, or modification by anyone other than an Approved Installer is dangerous and is expressly prohibited under the terms of this agreement.

**DELIVERY AND ACCEPTANCE OF PROPERTY.** Within Thirty (30) days of its installation, you are required to test the GenerLink™ unit with a generator. Written notice of any defects or concerns with the operation of the GenerLink™ unit must be received within Forty-Five (45) days from the installation date of the GenerLink™ unit by Global Power Products at 225 Arnold Road, Lawrenceville, GA 30044 specifying any defects, or it shall be conclusively presumed that you have accepted the GenerLink™ unit and found it to be in good operating condition and repair. This provision shall not be applicable to latent defects of which you could not reasonably be aware.

**SAFETY.** You understand and agree that once the GenerLink™ unit is installed, it is the only safe and allowable method for connecting a generator to your home. You grant the Utility the right to enter the site where the GenerLink™ unit is installed, to temporarily disconnect the generator, and to physically “lock out” the GenerLink™ unit at any time if the Utility determines that a potential hazard exists and that such temporary action is necessary to protect the Utility’s electric system, its customers, and/or its employees.

**INSPECTION, REMOVAL AND REPAIR.** You acknowledge that the GenerLink™ unit shall not be removed or removal by anyone other than an Approved Installer. If the GenerLink™ unit requires inspection, removal, repair, or replacement, immediately contact an Approved Installer to request that the GenerLink™ unit be removed. Contact GenerLink™ at 225 Arnold Road, Lawrenceville, GA 30044, or call at 1.800.886.3837 to receive instructions on how to have the GenerLink™ unit repaired and/or replaced.

**CLAIMS AND EXPENSES.** You expressly agree to hold the Utility, the Authorized GenerLink Reseller, and Global Power Products harmless from any and all claims, costs, expenses, damages, and liabilities, including reasonable attorney’s fees, resulting from, or alleged to be caused by, directly or indirectly, use, operation, or failure of the GenerLink™ unit.

**TERMS TO BE EXCLUSIVE.** You acknowledge that the Terms and Conditions constitute the final and entire agreement regarding the use and purchase of the GenerLink™ device.

**GOVERNING LAW.** It is expressly understood and agreed that the Terms and Conditions are to be interpreted according to the laws of the Georgia.

Copyright©2008byGlobalPowerProducts,Inc..Allrightsreserved.

No part of this document may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying, recording, or by an information storage or retrieval system without the prior written permission of Global Power Products unless such copying is expressly permitted by federal copyright law.

Address inquiries to:  
GenerLink  
225 Arnold Road  
Lawrenceville, GA 30044

# Warranty and Service Information.

---

## **GenerLink™ Manufacturers Limited Warranty**

Global Power Products warrants GenerLink for a period of one (7) year after delivery of goods, where specified that the goods are, under normal use and service, free from defects in materials, and workmanship. No other warranties or representations, whether written or oral, shall be binding upon Global Power Products. If any unit provided by Global Power Products does not comply with any of the expressed warranties set forth above and customer provides Global Power Products notice of such noncompliance within the one (7) year warranty period, Global Power Products shall at its discretion repair or replace the nonconforming unit after receipt of the nonconforming unit for its inspection. Global Power Products' sole liability to customer for goods not conforming to any of the express warranties is limited to repair or replacement of such units. Warranty on the repaired unit or any component thereof is limited to the balance of the original warranty period.

## **Surge Protection Manufacturers Limited Warranty Fifteen Year Product Coverage**

GPP will repair or replace any Surge Protection Device that is defective in material or workmanship or is damaged by an electrical surge (including those caused by lightning) for a period of fifteen (15) years from the date of installation or fifteen years and six (6) months from the date of manufacture, whichever comes first.

## **Lifetime White Goods Coverage**

GPP will repair or replace residential "White Goods Appliances" which sustain surge damage provided the Surge Protection Device was: fully functional immediately prior to the claim event, still under warranty and damaged by the claim event. Maximum coverage is \$1,000 per appliance, \$10,000 per residence.

A "White Goods Appliance" is defined as a washer, dryer, stove, refrigerator, freezer, HVAC unit, dishwasher or garbage disposal. Coverage is secondary to any applicable product warranties, service contracts and insurance policies.

This coverage applies to the end-user at the residence where the product is installed and is the exclusive remedy under this warranty, whether based on contract, tort, including negligence or otherwise. GPP reserves the right to audit damage, site and/or cost of repairs and may require a notarized proof of loss. Claims must be made within 30 days of damage. This warranty does not cover damage associated with sustained over voltages, vandalism, theft, normal wear and tear, obsolescence, abuse, unauthorized modification, misuse, improper installation, or catastrophic events. Except as expressed previously in this warranty, GPP disclaims liability of any incidental, indirect, special, or consequential damage arising out of the sale, lease, or use of any GPP product (including without limitation, lost business profits, loss of data and all freight, mileage, travel time, and insurance charges associated with the warranty coverage claims). Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above does not apply to you. This warranty gives you specific legal rights and you may have other rights which vary from state to state. This warranty is valid in the United States and Canada only.

**Surge Protection Warranty Assistance: Call 1-800-886-3837**

# Contents

---

<b>Setup Procedures</b>	<b>1</b>
<b>Status Lights</b>	<b>2</b>
<b>Audible Alarm</b>	<b>3</b>
 <b>Start-Up Procedure</b>	<b>4</b>
<b>The GenerLok™ Power Cord</b>	<b>7</b>
<b>Selecting a Portable Generator</b>	<b>11</b>
<b>Appliance Usage Guide</b>	<b>13</b>
<b>Sample Worksheets and Instructions</b>	<b>15</b>
<b>Technical Fact Sheets</b>	<b>17</b>
<b>Frequently Asked Questions</b>	<b>19</b>
<b>Troubleshooting Tips</b>	<b>22</b>
<b>Glossary of Terms</b>	<b>24</b>


## Setup Procedures

---

Carefully read all the instructions before using GenerLink.

The best time to prepare for a power outage is before there is an actual interruption of utility-supplied power. The following are suggested steps to prepare for an actual power outage using your portable generator and GenerLink.

- Determine which appliances are on each circuit breaker.  
*Note: circuit breakers may control more than one appliance.* We recommend you affix labels to each circuit breaker listing its appliances.
- Familiarize yourself with the typical power requirements of the appliances you expect to use during an outage, always taking into consideration the capacity of your generator. See Sample Worksheets located in this manual.
- Verify that the green status light on the GenerLink unit is illuminated. This light is located on the collar behind the connection cord below your electric meter. (See Diagram 1). The yellow status light may also be illuminated, this is a normal condition.

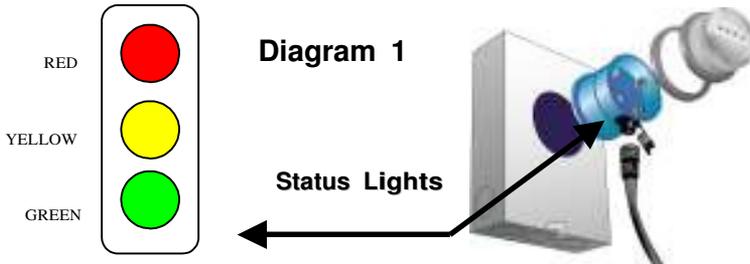

- Verify that the GenerLink unit is not emitting a constant audible alarm. This can only occur with units equipped with optional surge protection (Model #MA23/24-S). (See Audible Alarm section in this manual)

## Status Lights

---

GenerLink is equipped with one green status light, one yellow status light, and one red fault status light. (See Diagram 1)

**In the event of a power outage, none of the status lights will be illuminated.**

### **Green Status Light**

When the green status light is illuminated utility power is present. This represents a normal condition. If normal utility-supplied power is present in your home (you are not powering your home with a generator) and the green status light is NOT illuminated, maintenance is required and the unit must be serviced. Do not, under any conditions, attempt to remove or repair GenerLink yourself. (Refer to the Terms and Conditions for service instructions)

### **Yellow Status Light**

The yellow light indicates that the household load is greater than 30 amps. It is normal for the yellow status light to be illuminated while utility power is present. The load must be reduced before the GenerLink unit can be operated with a portable generator. Reduce the load by turning off circuit breakers in the breaker panel.

### **Red Status Light**

The red status light indicates an abnormal condition exists and GenerLink's safety circuits were initiated. Illumination of the red status light does not indicate an unsafe condition exists.

If the red fault status light is illuminated continuously, **DO NOT CONNECT** a generator to GenerLink. Service is required, immediately contact your Utility or the Approved Installer. (Refer to the Terms and Conditions for service instructions) It is normal for the red status light to momentarily illuminate when GenerLink cycles between generator and utility power.



### **WARNING**

**If the green status light is NOT illuminated when utility power is present, or the red fault status light IS illuminated, a potential hazardous condition may exist. Contact your electric utility or authorized installer.**

## Audible Alarm

---

**This section only applies to GenerLink units equipped with optional surge protection. Check the product label on unit collar for the model number. Units with a model number MA23-SorMA24-S contain the whole house surge suppression system.**

GenerLink units equipped with optional surge protection are also equipped with an audible alarm. The alarm will sound continuously if the surge components require service. (Refer to the Terms and Conditions for service instructions) Do not, under any conditions, attempt to remove or repair GenerLink yourself.

If the alarm is sounding, you **CAN CONNECT** a generator to GenerLink. The audible alarm is an indication that service may be required. An authorized utility technician or licensed electrician must service the device. (Refer to the Terms and Conditions for service instructions)

## Start-Up Procedures

The following are the start-up procedures for GenerLink. For generator start-up procedures, please refer to the generator manufacturer owner's manual.

**STEP 1:** Turn off all of the circuit breakers in your breaker panel. (See Diagram 2)

**Diagram 2**



**STEP 2:** Move your generator into position to be connected to GenerLink. Using the GenerLok™ power cord, insert the four-blade plug on the connecting cord into the 20-, 30- or 50-amp, 120/240-volt outlet on the generator.


**Do not attempt to connect your generator using a connection cord that is not fitted with GenerLok. Do not attempt to connect to a three-blade generator outlet or one rated higher than 50-amps. (See the GenerLok Power Cord section of this manual)**

**STEP 3:** To plug the GenerLok power cord into GenerLink, first locate the 'thumb guide' on the GenerLok connector. Align the 'thumb guide' with the front of the GenerLink receptacle. Insert the connector, there will be a snapping sound when the connector locks in place. (See Diagram 3)

**Note:** GenerLok cannot be connected successfully:

- if the thumb guide is not correctly aligned with the GenerLink receptacle or
- if the connector does not lock in place (no snapping sound)

**Diagram 3**

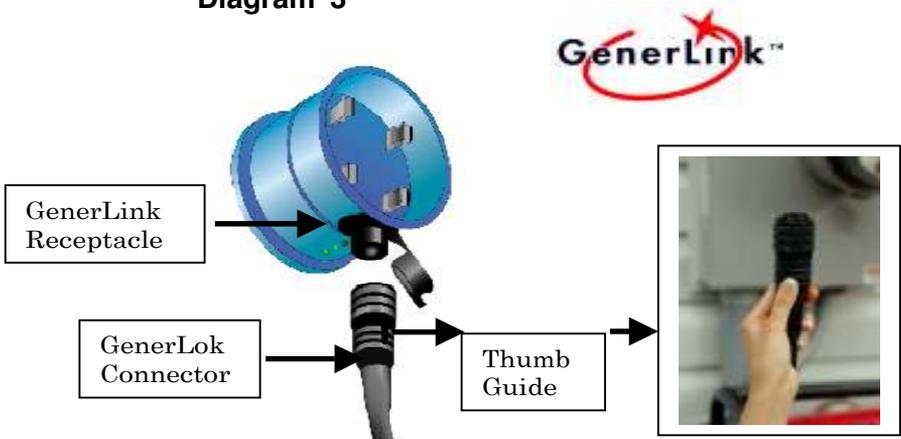

**STEP 4:** Turn off the idle setting (if present) on your generator. This will ensure that your generator will operate at the correct speed and voltage.

**STEP 5:** Review the generator starting procedures in the generator owner's manual and then start your generator.

**STEP 6:** *If your GenerLink unit is NOT equipped with optional surge protection (Model #MA23-S or MA24-S) please skip to Step 7.*

If after starting your generator, the GenerLink unit begins emitting a constant audible alarm, IT IS STILL SAFE TO OPERATE YOUR GENERATOR with GenerLink. The alarm indicates that the surge protection components may require service. (See Warranty and Service Section in this manual)

**STEP 7:** Select the appliances that require emergency power. Note the capacity of your generator and refer to the Appliance Energy Guide in this manual.

Locate the circuit breakers in your home's breaker panel (See Diagram 4) for the appliances you can support and turn them on one at a time. Start with large motor loads first, such as refrigerators. Motors require 2 to 3 times more power to start than other electrical appliances. Allow generator operation to stabilize before starting the next load. Next, start smaller motors such as a ceiling or ventilating fan. Then start smaller appliances with no motors such as lights.



**Diagram 4**

← **Breaker Panel**

**STEP 8:** When it is time to refuel your generator, turn off all of your home's circuit breakers before turning off the generator, and refuel according to your generator owner's manual. Then begin with Step 1 of the Start-Up Procedure to reconnect loads/appliances.



**WARNING**

**Before refueling your generator, consult the manufacturer's instructions as found in the generator owner's manual.**


**STEP 9:** If the generator’s circuit breaker trips off during operation or setup, turn off all circuit breakers in the breaker panel, reset the circuit breaker on the generator, and restart the generator if necessary. Select and reconnect loads following the procedures summarized in Step 7.

**STEP 10:** To determine when utility power has been restored, check the green status light (see Status Lights section in this manual). If the green light is illuminated, utility power is present and you can reconnect to the utility.

To reconnect to your electric utility:

- A. Turn off your generator. Expect to hear a ‘clicking’ sound from the GenerLink unit when the power transition occurs. This is a simple verification that normal utility service has been restored.
- B. On your breaker panel, set all circuit breakers to the ‘on’ position.
- C. You can now unplug the generator from GenerLink. To unplug GenerLink, gently pull down on the metal locking ring at the top of the GenerLok connector. (See Diagram 5) Store your power cord in a safe and dry location.

**Diagram 5**

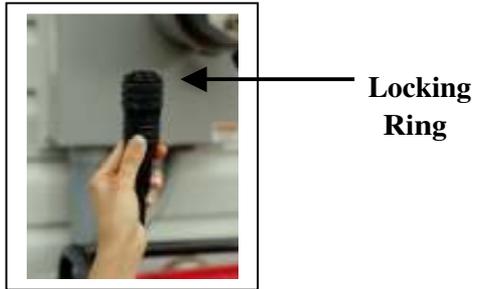

## The GenerLok™ Power Cord

To connect your portable generator to GenerLink a GenerLok power cord is required. The GenerLok power cord consists of three components:

- A. GenerLok™ connector
- B. connector for your generator
- C. 8 gauge power cord (4 wire)

### The GenerLok™ Connector:

GenerLink is equipped with GenerLok, a unique connector that allows for quick and easy connection to your portable generator. GenerLok locks in place when connected to GenerLink. GenerLok is not a threaded connector. Therefore, twisting of the locking sleeve is not necessary to ensure a tight connection. **NOTE:** GenerLok will always be fitted on one end of the power cord.



### The Generator Connector:

GenerLink is connected to the generator's 120/240-volt AC receptacle using a GenerLok power cord with the appropriate generator connection. Generators have different types of receptacles depending on the type of generator, the type of power provided, and the size of the generator. Some generators are rated for only 120-volt or only 240-volt output; neither are appropriate for powering your home through GenerLink. **If your generator does not have a 120/240-volt AC receptacle, it is not suitable for use with GenerLink.** Check your generator for one of the receptacles in Diagram 6. These receptacles are rated for 120/240-volt output, which is what you need to run your home. If your generator does not have one of these receptacles, it should not be used with GenerLink. Your GenerLok power cord will be fitted with a male plug compatible with one of the following generator receptacles.

Diagram 6



L14-20 Locking L14-30 Locking 14-50 Straight

### ***The Connection Cord:***

Connection cords are typically 20 to 40 feet long, with a maximum recommended length of 65 feet for a 50-amp circuit. To determine the correct cord length, follow these easy steps:

**STEP 1:** Select a location for your generator when it is being used with GenerLink. Consult your generator manufacturer's owner's manual for instructions on the acceptable placement of your generator.

**STEP 2:** Measure the length of the cord you will need by calculating the distance from the installed GenerLink to your generator, including the vertical distance from the electric meter to the ground.

The length of the power cord should always be as close as possible to the actual measured distance from the electric meter in order to maximize your generator's power quality. Additionally, the power cord must be fully unrolled during use.

### **NOTE:**

**The GenerLok power cord is the only power cord approved for use with GenerLink. The GenerLok connector can only be used with GenerLink. It is not compatible for use with any other electric appliance/device.**

## Surge Protection (Optional MA-23-S or MA-24-S)

To determine if your GenerLink unit is equipped with surge protection, check the product label on the collar of the device for the **modelnumberMA23SorMA24-S**.

### What are Surges?

A surge is a sudden, unpredictable, powerful increase in voltage that can damage or destroy household appliances and electronic equipment. Surge damage can happen all at once in cases of high voltage surges or over a period of time when lower voltage surges are experienced consistently.

### How to Protect Your Home and Appliances from Voltage Surges.

Surges can occur on power, cable TV, telephone and data lines. They are caused by many sources: lightning, the switching of utility equipment on the electric grid, electrical accidents, heavy motor or heavy loads from a nearby industry or locally, by microwave ovens, laser printers and copiers, air conditioner compressor motors and even lights being turned on and off.

#### **GenerLink with Surge Protection:**

- Protects household equipment including appliances and hard-wired systems not protected by power strips. Plus, it provides enhanced protection for household electronics.
- Provides protection beyond typical point-of-use power strips and plug-ins.
- Produces an audible alarm when the devices requires service.
- Protects against spikes up to 100,000 amps on the electric system.
- Provides a lifetime white goods warranty of \$1,000/appliance and/or \$10,000/house.
- Is meter-based and will provide the first line of defense at your home's service entrance and for your wired appliances from voltage surges. (Refer to the Terms and Conditions for service instructions)

To protect sensitive plugged-in appliances and equipment, you should combine GenerLink (with surge protection) with outlet-strip/ plug-in surge protectors. Purchase high quality plug-in strips to protect sensitive equipment and appliances such as your computer and audio/visual equipment. Always consult your specific appliance owner's manual before installing plug-in surge strips.

## Safety Tips

---

Do not wait for an emergency to learn how to connect your generator and select loads to GenerLink. (See Setup Procedures for detailed information.)

- Do not connect the GenerLok power cord to GenerLink if the red fault status light is continuously illuminated.
- Never connect or disconnect the GenerLok power cord to/from your portable generator while the generator is operating. Turn off the portable generator and turn off all circuits in your breaker panel before connecting or disconnecting the power cord.
- Before using the GenerLok power cord, check the cord for exposed wires and/or frayed insulation.
- Keep the power cord stored in a dry, safe location when not in use.
- Ensure that the GenerLok power cord is in a protected area where it will not be damaged by lawn mowers, power tools or vehicles.
- Never attempt to remove, repair, dismantle, modify, or alter GenerLink once it has been installed.



### CAUTION

**Always locate and operate your generator in accordance with the manufacturer's instructions as outlined in the generator owner's manual.**

## Selecting a Portable Generator

---

### ***What Kind of Generator Do I Need?***

There are a wide variety of portable generators available for purchase. Some are more suitable than others for connecting to your house. When selecting a portable generator to connect to your house, you should ensure the generator:

- will not damage sensitive electronic appliances/equipment
- provides the capacity to start needed motor loads, such as a well or sump pump
- has the necessary four-wire 20-amp or 30-amp or 50-amp receptacle required to connect to GenerLink and
- has a 120/240-volt connector.



***As a guide, GenerLink should be used with a generator that has the following features:***

- a peak rating sufficient to start the largest motor you will be running
- an automatic voltage regulator
- 'low oil' shut down
- 14-20 or 14-30 locking or 14-50 straight receptacle for connecting to GenerLink and
- 120/240-volt output

The quality of power produced by a portable generator is also an important factor to consider when selecting your generator. If the voltage output is too low, it could cause motors, such as your refrigerator or furnace motor, to overheat. If the voltage output is too high, it could damage sensitive electronic equipment such as your computer or the digital controls on your heating system.

To maximize your generator's power quality, it is recommended that your generator have automatic voltage regulation. Electronic voltage regulation is preferred over capacitor or condenser type regulation in instances where sensitive electronic equipment is being operated.

### ***What Size Generator Do I Need?***

During a power outage, GenerLink allows you to select the combination of loads/appliances you want to operate by simply switching breakers in the household breaker panel. This flexibility makes generator sizing easy.

You will want a generator that can run the largest appliances and motors you will need during an outage. You can always run other smaller loads/appliances by rotating them on and off as necessary.

For example, if you have a generator with 9600 continuous watts of capacity, during a power outage, you can run the hot water heater (typically 4800 watts) by simply turning off the majority of other household breakers until the water tank heats up. Once the water is heated, shut off the water heater breaker and switch the other household circuit breakers back on.

To determine the loads you can support with a portable generator, you must consider both the “running watt” and the “starting watt” requirements of the loads you want to operate. (See Appliance Energy Guide in this manual)

**You can purchase or use a generator of any size provided the generator is equipped with a 4 wire, 120/240-volt receptacle rated at 20-amps, 30-amps and/or 50-amps.** GenerLink is designed to be compatible with 20-amp, 30-amp and 50-amp connectors. GenerLink is not rated to be compatible with larger current outputs and will electronically disconnect if you are generating outputs larger than 40-amps.

# Appliance Usage Guide

---

Equipment	Starting Factor	Running Wattage (avg.)
Water Heater (50 gallon)	1	4500-5000
Portable Heater with fan	2	500-1500
Furnace Fan (Central) - 1/4 HP	3	400
1/3 HP	3	450
1/2 HP	3	600
Computer	1	200
Fax Machine	1	50-1000
Space Heater	1	500-1500
Refrigerator/Freezer	3	750
Home Security System	1	200
Lights	1	40-150
Range w/Oven	1	12200
- Small Burner	1	1300
- Large Burner	1	2400
Garage Door Opener - 1/3 HP	3	750
- 1/2 HP	3	1050
Well Pump - 1/3 HP	3	750
1/2 HP	3	1000
3/4 HP	3	1500
Submersible Sump Pump - 1/2 HP	3	1000
Electric Heat Pump	3	6000
Central A/C 3 ton	3	6000
Dishwasher w/o hot water	2	1200
Television	1	150-400
Radio	1	70-200
Microwave	1	600-1500
Coffee maker	1	750-1200
Toaster	1	1100
Hair Dryer	2	600-1400
Washing Machine w/o Hot Water	2	1000
Clothes Dryer	2	4850
Air Cleaner	2	50
Dehumidifier	2	840
Humidifier	1	177
Vacuum Cleaner	1	800

## Notes to Appliance Usage Guide

The wattages on the Appliance Energy Guide are estimates. The estimated wattage required for your appliances can be easily calculated. (*NOTE: 1 kW=1000 watts; 2 kW=2000 watts and so on.*) The formula for finding wattage is: Volts x Amps = Watts (running). Always use starting factor when calculating electrical load requirements for your generator. Select the appliances you want to operate and add the starting wattages together to determine if they can all be operated at the same time without exceeding the capacity of your generator. *NOTE: individual circuit breakers on your breaker panel may control more than one appliance.* Always determine which appliances/loads are connected to specific breakers.



### CAUTION

**Do not turn on your home's heat pump or central air conditioning while using GenerLink. The starting wattage for these devices exceeds GenerLink's 30-amp or 40 amp capacity.**

### Worksheet Instructions

Write down the maximum and continuous wattage output ratings for your generator in the boxes marked A.

From the Appliance Energy Guide, select the appliances that you wish to operate and write them in column B. For each selected appliance, write its corresponding starting factor and run watts in columns C and D respectively.

For each appliance that you have selected, multiply the starting factor by the run watts and write the results or the load watts in column E. *NOTE: Only items that start simultaneously should be tallied in column D.*

Finally, sum up all of the load wattages for each appliance and lights in column E. Add each appliances load watts and write the number in box G. The number in box G represents the total amount of load you plan to run on your portable generator. Be sure that the total in box G does not exceed the generator size in box A.

Always select a generator that is as large as or larger than the estimates for both running and starting wattages.

---

VISIT OUR INTERACTIVE WORK SHEET AT  
[www.generlink.com](http://www.generlink.com)

---

SAMPLE WORKSHEET

Generator Size: (Watts) | 7200 |

B Load	C Start Factor	X	D Run Watts	=	E Load Watts
Refrigerator	3	X	1000	=	3000
Sump Pump	2	X	1000	=	2000
Computer	1	X	200	=	200
Fan (central) ¼ hp	3	X	400	=	1200
		X		=	
		X		=	

Lights	F		=	G
	Wattage	Number		
				300
	60	X	5	
	100	X		
			1	100
	150	X		

Total: 6800 G

# WORKSHEET A

Generator Size:  
(Watts)

B	C		D	E
Load	Start Factor	X	Run Watts	= Load Watts

<input type="text"/>	<input type="text"/>	X	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	X	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	X	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	X	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	X	<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>	X	<input type="text"/>	<input type="text"/>

			F
Lights	Wattage		Number

	60	X	<input type="text"/>	<input type="text"/>
	100	X	<input type="text"/>	<input type="text"/>
	150	X	<input type="text"/>	<input type="text"/>

Total:  G

# Technical Fact Sheet

## GenerLink Specifications and Technical Information



### Physical

Diameter:	6 ½ in.
Depth:	5 ¼ in.
Weight w/o surge:	5 ½ lbs
Weight with surge:	5 ¾ lbs
Socket Style:	Ring or Ring-less, 200 Amp, 4 jaw

### Electrical

Source Compatibility:	200 Ampere Service or Less
Withstand Current:	10,000 Amperes rms symmetrical at .5 pf, 240 Volts, 60 Hz 6000 Amperes for 6 cycles at .7 - .8 pf, 240 Volts, 60 Hz

Generator Input: 10kW Continuous<sup>†</sup>, 120/240 Volt

Connection: 7.2kW Continuous<sup>†</sup> for MA23

Proprietary GenerLok™ QuickConnect Power<sup>†</sup> Cord<sup>‡</sup>

### Operational

Transfer Type:	Break–Before–Make
Transfer Delay:	2-3 Seconds
Life Cycle:	300,000 Operations
Temperature Range:	-30°C to 60°C External Ambient

### Features

Generator Input Protection: Generator Input Voltage  $\geq$  200 Volts  
Supplemental Overcurrent  $\leq$  40 A

Utility Input Protection: Utility Input Voltage  $\geq$  180 Volts  
Over-Temperature Trip  $\geq$  105°C

Load Protection: Integrated Whole-House  
Surge Protection (Optional)

Status Indication: Long-life LED indicators show utility power  
availability and/or fault presence

<sup>†</sup> 3 hours at 25° C/ 77° F ambient

<sup>‡</sup> Sold Separately

\* When protected by max 200 A circuit breaker in series with 100 A branch circuit breaker

## Surge Protection Specifications and Technical Information

Nominal Line Voltage:	120/240	
Max Cont. Operating Voltage:	250	
Operating Frequency:	60 Hz	
Total Surge Current:	100000 A	
Max Surge Current Per Mode:	50000 A	L1 - G
	50000A	L2 - G

Circuit Type:	Parallel High Energy
Storage Temperature:	-40° to +160° F (-40° to +70° C)
Operating Temperature:	-40° to +140° F (-40° to +60° C)
Operating Altitude:	Sea Level to 12,000 feet (3,658 Meters)

### Performance

ANSI/IEEE C62.41:	
Category A3 200A	600 V
Category B3 500A	660 V
Category C1 3000A	690 V

EMI/RFI noise rejection:	Up to -20dB
--------------------------	-------------

## Frequently Asked Questions

---

### **Q. Do I need a generator in order to use GenerLink?**

A. Yes. GenerLink is an interconnection device that enables you to connect your portable generator directly to your home's wiring system. During a power outage, your generator becomes your source of emergency back-up power. GenerLink is designed as an alternative to expensive transfer switches and hazardous extension cords.

### **Q. How is GenerLink different from a transfer switch?**

A. GenerLink offers several advantages over traditional transfer switches:

- GenerLink is installed outside your home at the electric meter in less than 30 minutes. And, in most cases, you do not need to be at home for the GenerLink installation. Installation of a transfer switch can take about two to three hours and requires re-wiring your home's electric system.
- With GenerLink, you have the flexibility of selecting the appliances you want to run from your home's breaker panel, up to the capacity of your generator. Most basic transfer switches have 6 to 8 hard-wired circuits. This limits the number of circuits you can connect to the transfer switch.
- Since GenerLink uses your existing breaker panel, you can run any large 120 or 240-volt appliance up to your generator's capacity. Your well pump, water heater, sump pump, electric range, clothes dryer and electric baseboard heat are just some of the appliances that can be run on a rotation basis with GenerLink. Many transfer switches and sub panels have only one or two 240-volt circuits rated at 15 or 20-amps. Heavier loads, such as hot water heaters and electric ranges, may not be accommodated by these transfer switches and sub panels.

### **Q. Is there any potential for damage to my appliances?**

A. GenerLink is designed to function as an interconnection device and serves to connect your generator to your home. There is no risk of damage to your appliances created by the GenerLink device. You should exercise care when selecting your generator to ensure you are buying a high quality generator.

### **Q. I want surge protection for my home and appliances, can I still use GenerLink?**

A. Yes, GenerLink is now available with an optional feature –surge protection. GenerLink with surge protection will protect your home and wired appliances from surges over 600 volts.

**Q. I have meter-based surge protection, but want GenerLink. Should I get hard-wired surge protection?**

A. If your GenerLink unit is equipped with whole house surge protection it will eliminate the need for meter based or hard wired surge protection devices.

**Q. Why can't I run my whole house from a portable generator?**

A. The appliances in the average home consume relatively low amounts of electricity to operate once they are started. However, many of them require a significant amount of electricity to start up the appliances. Please review the appliance guide to determine the start-up wattage required for individual appliances.

**Q. What happens when the utility power is restored and my generator is operating through GenerLink?**

A. Your generator continues to power your home until you turn it off. Once you turn off your generator, GenerLink will automatically switch your home back to utility power. GenerLink has a built-in safety feature that prevents back feeding the generator's power into the utility lines, eliminating hazardous conditions for you and for utility service personnel.

**Q. What maintenance is required for GenerLink?**

A. There is no regular maintenance required for GenerLink.

**Q. Does my utility meter continue to run when using GenerLink with my generator?**

A. No, your utility meter will only run when the utility is providing electric power to your home. When using GenerLink, with your portable generator, you are automatically disconnected from the utility power supply and will not reconnect until you turn off your generator.

**Q. How can I tell when the utility power is restored?**

A. There are three indicator lights on GenerLink, one green, one yellow and one red. When the green light is illuminated, this represents a normal condition where utility power is present. When your utility has restored power you can de-energize and disconnect your generator from GenerLink. If the red light is illuminated at any time or in conjunction with the green light, there is a potential problem and you should have the unit serviced immediately. (Refer to the Terms and Conditions for service instructions)

**Q. Can I use GenerLink during inclement weather?**

A. GenerLink is completely sealed inside the meter socket and does not represent a hazard; however, generators should not be operated during rain or snow unless they are protected from the elements. Please consult your generator manufacturer, distributor and/or owner's manual for instructions on the safe operation of your generator.

**Q. What happens if the generator gets overloaded?**

A. Your generator should have a circuit breaker that will activate in the event of an overload. If it does not have this feature, it is not suitable for use with GenerLink. If the generator's circuit breaker trips, turn off all the household circuit breakers in your breaker panel, reset the circuit breaker on the generator, and restart the generator. Please refer to your generator owner's manual for complete instructions on the safe operation of your generator.

**Q. Where should the generator be placed?**

A. Remember, generator exhaust gases contain deadly carbon monoxide. The generator should never be operated inside, this includes basements, crawl spaces and/or attached garages. Please consult your generator owner's manual for complete instructions on the safe location for and operation of your generator.

**Q. What is a power cord?**

A. A power cord consists of:

- a standard GenerLok connector that will attach to GenerLink,
- a four wire, 8 gauge cable that is
- insulated, heavy duty, outdoor rated, water-resistant and
- an appropriate NEMA connector for your generator.

Your generator may have a 20-amp, 30-amp, or 50-amp 120/240-volt output that will require a 20-amp, 30-amp, or 50-amp NEMA connector. The length of the power cord should be as close to the actual measured distance from the meter to the generator as possible in order to maintain your generator's power quality.

**Q. What gauge wire is used to make the cord?**

A. 10 gauge wire is used. The cord is heavy duty, outdoor rated, fire and water resistant and is appropriate for cords up to 65 feet for a 50- amp circuit.

**Q. What if my generator connector does not have a straight or locking 14-20,14-30, or 14-50 connector?**

A. Some generators are fitted with connectors that are not 14-20, 14-30 or 14-50. Consult with your local utility or a GenerLink Authorized Reseller to determine if your generator can be used to connect with GenerLink.

**Q. What happens if I want GenerLink removed from my home?**

A. To remove, replace, or repair your GenerLink, you must contact an Approved Installer. Only technicians authorized by the electric utility or licensed electricians may have access to GenerLink. Do not, under any conditions, attempt to remove and/or repair GenerLink yourself.

### **Problem**

The GenerLink will not transfer to the generator during testing with utility power present.

### **Cause**

The GenerLink unit is equipped with a lockout circuit that prevents transfer to generator power if the load on the home exceeds 50-amperes. The yellow status light will be illuminated if the load exceeds 50-amperes.

### **Solution / TESTING**

1. Disconnect the generator.
2. Reduce the load by turning off ALL the circuit breakers in the house.
3. Confirm that the yellow status light is not illuminated.
4. Reconnect and restart the generator.
5. Restore load equal to or less than the capacity of generator.
6. Operate household loads using your generator.
7. Do not, under any conditions, attempt to remove or repair GenerLink yourself.

### **Problem**

GenerLink will not continuously connect the generator to the loads or it periodically cycles the loads on and off.

### **Cause**

GenerLink is equipped with load sensing capabilities. If it detects a connected load that exceeds the 50 amp continuous load rating, it will automatically disconnect the generator for a short period of time.

### **Solution**

Reconnect GenerLink through a 20-amp, 30-amp or 50-amp connector.

### **Problem**

The green indicator light on GenerLink is not illuminated when utility power is present.

### **Cause**

The green status light on the bottom of the GenerLink must be illuminated when utility power is present. If it is not illuminated, this may indicate an abnormal condition that may require service.

### **Solution**

1. Call for service. (Refer to the Terms and Conditions for service instructions)
2. Do not attempt to test or use the GenerLink with a generator until the condition is corrected.
3. Do not, under any conditions, attempt to remove and/or repair GenerLink yourself.

**Problem**

After the generator is turned off and utility power is present, the house loads begin to cycle on and off.

**Cause**

While connected to the generator, GenerLink may have suffered an internal failure.

**Solution**

1. Reduce the load by turning off all circuit breakers in the house.
2. Reconnect and restart the generator.
3. Restore load equal to the capacity of generator.
4. Operate household loads using your generator.
5. Call for service. (Refer to the Terms and Conditions for service instructions)
6. Do not, under any conditions, attempt to remove or repair GenerLink yourself.

## Glossary of Terms

---

**Amp (Ampere):** The amount of electricity or current flowing through a wire, similar to the flow of water through a pipe.

**Back feed:** A condition where electricity is being generated from a source outside the utility power grid and is feeding/traveling back into the power lines.

**Breaker Panel:** The main circuit breaker panel (or fuse box) is where all the circuits/fuses connect to the incoming electrical supply line from the utility.

**Breakers:** See Circuit Breaker

**Capacity:** The amount of power, expressed in watts, kilowatts or megawatts, that a device can provide at any given instant.

**or**

The maximum load of electricity that equipment can carry.

**Circuit:** A continuous loop of current.

**Circuit Breaker:** The most common type of “overcurrent protection.” A resettable switch that trips when a circuit becomes overloaded or shorts out.

**Connection Cord:** An electrical receptacle and plug wired to a length of flexible electrical cord.

**Continuous:** Output The amount of power produced continuously as opposed to the maximum output, which can only be produced for short periods of time.

**Current:** The rate at which electricity flows, measured in amperes.

**Electric Panel:** See Breaker Panel

**Fuses:** Removable devices that link a circuit at the fuse box. A non-resettable overcurrent device.

**Generator:** A machine that converts mechanical energy into electrical energy.

**GenerLink:** A five-inch collar-like device installed behind your electric meter, which allows you to easily and safely connect a portable generator to your home’s existing wiring system.

**GenerLok:** GenerLok is a unique fitted locking connector, exclusively available for GenerLink.

**Hardwire:** Process of wiring electric appliances directly into the electric power supply.

**Indicator Lights:** See Status Lights

**Load Watts:** See Start-up Wattage

**Loads:** A source drives a load. An appliance, component or other device that requires current to operate.

**Meter:** Any electrical or electronic device used to measure the amount of electricity consumed.

**NEMA:** National Electrical Manufacturers Association. A standard which specifies the electrical connectors used on plug-in equipment.

**Overload:** A condition that occurs when the load is greater than the system/device is designed to handle.

**Power Cord:** See Connection Cord

**Power Outage:** A temporary loss of electric power or temporary disconnection from the electric utility.

**Running Wattage:** The amount of energy necessary to continue running an appliance once it has started.

**Status Lights:** GenerLink status lights are designed to display power conditions with the GenerLink unit, the utility and the portable generator.

**Start-up Wattage:** The amount of energy needed to first start an appliance. This amount is usually larger than the running wattage for appliances with motors (refrigerator). It is usually the same for appliances without motors (lights).

**Sub Panel:** Device used in connection with a transfer switch designed to bypass a breaker panel and limits the amount of load or number of appliances that can be placed on a generator.

**Surge:** A power disturbance known also as a transient voltage.  
or  
A brief but extreme burst of energy.

**Surge Protection:** Any device designed to limit or eliminate transient voltages from entering power, signal, telephone or data lines.

**Transfer Switch:** Used in conjunction with a sub panel. Device installed by a licensed electrician designed to allow interconnection of a portable generator with limited appliance availability.

**Utility's Electric Distribution System:** A network of power lines and associated equipment used to transmit and distribute electricity over a geographic area.

**Voltage:** Electrical potential or force that causes current to flow through a conductor.

**Watt:** A unit that measures the amount of electrical power.  $\text{watts} = \text{volts} \times \text{amps}$

## Important Installation Information

---

You **MUST** have this information should the unit need repair or replacement. Please complete the information and keep this information for future reference

Installation Date:

---

Company Name:

---

Address: \_\_\_\_\_

---

Phone Number:

---

Installer Company Name:

---

GenerLink Serial Number:

---

GenerLink™ unit shall not be removed or uninstalled by anyone other than an Approved Installer. If the GenerLink™ unit requires inspection, removal, repair, or replacement, immediately contact the Approved Installer or a licensed electrician to request that the GenerLink™ unit be removed. Once the GenerLink™ unit is removed, contact GenerLink™ at 225 Arnold Road, Lawrenceville, GA 30044, or call at 1.800.886.3837 to receive instructions on how to have the GenerLink™ unit repaired and/or replaced



---

## Operating Manual

---

GenerLink™  
225 Arnold Road  
Lawrenceville, GA 30044  
[www.generlink.com](http://www.generlink.com)

OPER-MA 23/24-N/S  
1.3.12